

# 2018 ANNUAL GROUNDWATER MONITORING AND CORRECTIVE ACTION REPORT

## CCR LANDFILL AND LOWER AQC IMPOUNDMENT LA CYGNE GENERATING STATION LA CYGNE, KANSAS

Presented To:  
Kansas City Power & Light Company

**SCS ENGINEERS**

27217233.18 | January 2019  
8575 W 110<sup>th</sup> Street, Suite 100  
Overland Park, Kansas 66210  
913-681-0030

## CERTIFICATIONS

I, John R. Rockhold, being a qualified groundwater scientist and Professional Geologist in the State of Kansas, do hereby certify that the 2018 Annual Groundwater Monitoring and Corrective Action Report for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station was prepared by me or under my direct supervision and fulfills the requirements of 40 CFR 257.90(e).




---

John R. Rockhold, P.G.

SCS Engineers

I, Douglas L. Doerr, being a qualified licensed Professional Engineer in the State of Kansas, do hereby certify that the 2018 Annual Groundwater Monitoring and Corrective Action Report for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station was prepared by me or under my direct supervision and fulfills the requirements of 40 CFR 257.90(e).

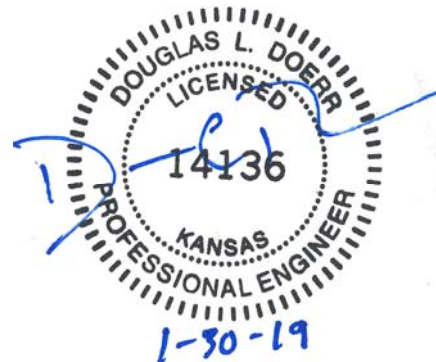

---

Douglas L. Doerr, P.E.

SCS Engineers

# 2018 Groundwater Monitoring and Corrective Action Report

Revision Number	Revision Date	Revision Section	Summary of Revisions

## Table of Contents

Section	Page
<b>CERTIFICATIONS</b> .....	<b>i</b>
<b>1 INTRODUCTION</b> .....	<b>1</b>
<b>2 § 257.90(e) ANNUAL REPORT REQUIREMENTS</b> .....	<b>1</b>
2.1 § 257.90(e)(1) Site Map.....	1
2.2 § 257.90(e)(2) Monitoring System Changes.....	1
2.3 § 257.90(e)(3) Summary of Sampling Events.....	2
2.4 § 257.90(e)(4) Monitoring Transition Narrative.....	2
2.5 § 257.90(e)(5) Other Requirements.....	2
2.5.1 § 257.90(e) Program Status .....	2
2.5.2 § 257.94(d)(3) Demonstration for Alternative Detection Monitoring Frequency... 3	3
2.5.3 § 257.94(e)(2) Detection Monitoring Alternate Source Demonstration.....	3
2.5.4 § 257.95(c)(3) Demonstration for Alternative Assessment Monitoring Frequency .....	4
2.5.5 § 257.95(d)(3) Assessment Monitoring Concentrations and Groundwater Protection Standards .....	4
2.5.6 § 257.95(g)(3)(ii) Assessment Monitoring Alternate Source Demonstration .....	4
2.5.7 § 257.96(a) Demonstration for Additional Time for Assessment of Corrective Measures .....	4
<b>3 GENERAL COMMENTS</b> .....	<b>5</b>

### Appendices

#### Appendix A Figures

Figure 1: Site Map

#### Appendix B Tables

Table 1: Appendix III Detection Monitoring Results

Table 2: Detection Monitoring Field Measurements

#### Appendix C Alternative Source Demonstrations

C.1 Groundwater Monitoring Alternative Source Demonstration Report October 2017 Groundwater Monitoring Event

C.2. Groundwater Monitoring Alternative Source Demonstration Report May 2018 Groundwater Monitoring Event

## 1 INTRODUCTION

This 2018 Annual Groundwater Monitoring and Corrective Action Report was prepared to support compliance with the groundwater monitoring requirements of the “Coal Combustion Residuals (CCR) Final Rule” (Rule) published by the United States Environmental Protection Agency (USEPA) in the *Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals from Electric Utilities; Final Rule*, dated April 17, 2015 (USEPA, 2015). Specifically, this report was prepared to fulfill the requirements of 40 CFR 257.90 (e). The applicable sections of the Rule are provided below in *italics*, followed by applicable information relative to the 2018 Annual Groundwater Monitoring and Corrective Action Report for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station.

## 2 § 257.90(E) ANNUAL REPORT REQUIREMENTS

*Annual groundwater monitoring and corrective action report. For existing CCR landfills and existing CCR surface impoundments, no later than January 31, 2018, and annually thereafter, the owner or operator must prepare an annual groundwater monitoring and corrective action report. For new CCR landfills, new CCR surface impoundments, and all lateral expansions of CCR units, the owner or operator must prepare the initial annual groundwater monitoring and corrective action report no later than January 31 of the year following the calendar year a groundwater monitoring system has been established for such CCR unit as required by this subpart, and annually thereafter. For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve the problems, and project key activities for the upcoming year. For purposes of this section, the owner or operator has prepared the annual report when the report is placed in the facility’s operating record as required by § 257.105(h)(1). At a minimum, the annual groundwater monitoring and corrective action report must contain the following information, to the extent available:*

### 2.1 § 257.90(E)(1) SITE MAP

*A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit;*

A site map with an aerial image showing the CCR Landfill and Lower AQC Impoundment and all background (or upgradient) and downgradient monitoring wells with identification numbers for the CCR Landfill and Lower AQC Impoundment groundwater monitoring program is provided as **Figure 1** in **Appendix A**.

### 2.2 § 257.90(E)(2) MONITORING SYSTEM CHANGES

*Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken;*

No new monitoring wells were installed and no wells were decommissioned as part of the CCR groundwater monitoring program for the CCR Landfill and Lower AQC Impoundment in 2018.

## 2.3 § 257.90(E)(3) SUMMARY OF SAMPLING EVENTS

*In addition to all the monitoring data obtained under §§ 257.90 through 257.98, a summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring programs;*

Only detection monitoring was conducted during the reporting period (2018). Samples collected in 2018 were collected and analyzed for Appendix III detection monitoring constituents as indicated in **Appendix B, Table 1** (Appendix III Detection Monitoring Results, and **Table 2** (Detection Monitoring Field Measurements). The dates of sample collection, the monitoring program requiring the sample, and the results of the analyses are also provided in these tables. These tables include both the Spring 2018 semiannual detection monitoring data and the Fall 2018 semiannual detection monitoring data.

## 2.4 § 257.90(E)(4) MONITORING TRANSITION NARRATIVE

*A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels); and*

There was no transition between monitoring programs in 2018. Only detection monitoring was conducted in 2018.

## 2.5 § 257.90(e)(5) OTHER REQUIREMENTS

*Other information required to be included in the annual report as specified in §§ 257.90 through 257.98.*

A summary of potentially required information and the corresponding section of the Rule is provided in the following sections. In addition, the information, if applicable, is provided.

### 2.5.1 § 257.90(e) Program Status

*Status of Groundwater Monitoring and Corrective Action Program.*

The groundwater monitoring and corrective action program is in detection monitoring.

*Summary of Key Actions Completed.*

- a. completion of the statistical evaluation of the initial Fall 2017 semiannual detection monitoring event per the certified statistical method,
- b. completion of the 2017 Annual Groundwater Monitoring and Corrective Action Report,
- c. completion of a successful alternative source demonstration for the Fall 2017 semiannual detection monitoring event,
- d. completion of the Spring 2018 semiannual detection monitoring sampling and analysis event, and subsequent verification sampling per the certified statistical method,
- e. completion of the statistical evaluation of the Spring 2018 semiannual detection monitoring

event per the certified statistical method,

- f. completion of a successful alternative source demonstration for the Spring 2018 semiannual detection monitoring event, and
- g. initiation of the Fall 2018 semiannual detection monitoring sampling and analysis event.

*Description of Any Problems Encountered.*

No noteworthy problems were encountered.

*Discussion of Actions to Resolve the Problems.*

Not applicable because no noteworthy problems were encountered.

*Projection of Key Activities for the Upcoming Year (2019).*

Semiannual Spring and Fall 2019 groundwater sampling and analysis. Completion of verification sampling and analyses and statistical evaluation of Fall 2018 and Spring 2019 detection monitoring data and, if required, alternative source demonstration(s).

## 2.5.2 § 257.94(d)(3) Demonstration for Alternative Detection Monitoring Frequency

*The owner or operator must obtain a certification from a qualified professional engineer or approval from the Participating State Director or approval from EPA where EPA is the permitting authority stating that the demonstration for an alternative groundwater sampling and analysis frequency meets the requirements of this section. The owner or operator must include the demonstration providing the basis for the alternative monitoring frequency and the certification by a qualified professional engineer or the approval from the Participating State Director or approval from EPA where EPA is the permitting authority in the annual groundwater monitoring and corrective action report required by § 257.90(e).*

Not applicable because no alternative monitoring frequency for detection monitoring and certification was pursued.

## 2.5.3 § 257.94(e)(2) Detection Monitoring Alternate Source Demonstration

*Demonstration that a source other than the CCR unit caused the statistically significant increase (SSI) over background levels for a constituent or that the SSI resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. In addition, certification of the demonstration is to be included in the annual report.*

The following reports are included as **Appendix C**:

- C.1 CCR Groundwater Monitoring Alternative Source Demonstration Report October 2017 Groundwater Monitoring Event, CCR Landfill and Lower AQC Impoundment, La Cygne Generating Station (April 2018).

- C.2. Groundwater Monitoring Alternative Source Demonstration Report May 2018  
Groundwater Monitoring Event, CCR Landfill and Lower AQC Impoundment, La Cygne  
Generating Station (December 2018).

#### 2.5.4 § 257.95(c)(3) Demonstration for Alternative Assessment Monitoring Frequency

*The owner or operator must obtain a certification from a qualified professional engineer or approval from the Participating State Director or approval from EPA where EPA is the permitting authority stating that the demonstration for an alternative groundwater sampling and analysis frequency meets the requirements of this section. The owner or operator must include the demonstration providing the basis for the alternative monitoring frequency and the certification by a qualified professional engineer or the approval from the Participating State Director or the approval from EPA where EPA is the permitting authority in the annual groundwater monitoring and corrective action report required by § 257.90(e).*

Not applicable because there was no assessment monitoring conducted.

#### 2.5.5 § 257.95(d)(3) Assessment Monitoring Concentrations and Groundwater Protection Standards

*Include the concentrations of Appendix III and detected Appendix IV constituents from the assessment monitoring, the established background concentrations, and the established groundwater protection standards.*

Not applicable because there was no assessment monitoring conducted.

#### 2.5.6 § 257.95(g)(3)(ii) Assessment Monitoring Alternate Source Demonstration

*Demonstrate that a source other than the CCR unit caused the contamination, or that the statistically significant increase resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. Any such demonstration must be supported by a report that includes the factual or evidentiary basis for any conclusions and must be certified to be accurate by a qualified professional engineer. If a successful demonstration is made, the owner or operator must continue monitoring in accordance with the assessment monitoring program pursuant to this section, and may return to detection monitoring if the constituents in appendices III and IV to this part are at or below background as specified in paragraph (e) of this section. The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer or the approval from the Participating State Director or approval from EPA where EPA is the permitting authority.*

Not applicable because there was no assessment monitoring conducted.

#### 2.5.7 § 257.96(a) Demonstration for Additional Time for Assessment of Corrective Measures

*Within 90 days of finding that any constituent listed in appendix IV to this part has been detected at a statistically significant level exceeding the groundwater protection standard defined under § 257.95(h), or immediately upon detection of a release from a CCR unit, the owner or operator must initiate an assessment of corrective measures to prevent further releases, to remediate any releases*



*and to restore affected area to original conditions. The assessment of corrective measures must be completed within 90 days, unless the owner or operator demonstrates the need for additional time to complete the assessment of corrective measures due to site-specific conditions or circumstances. The owner or operator must obtain a certification from a qualified professional engineer attesting that the demonstration is accurate. The 90-day deadline to complete the assessment of corrective measures may be extended for no longer than 60 days. The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer or the approval from the Participating State Director or approval from EPA where EPA is the permitting authority.*

Not applicable because there was no assessment monitoring conducted.

### 3 GENERAL COMMENTS

This report has been prepared and reviewed under the direction of a qualified groundwater scientist and qualified professional engineer. The information contained in this report is a reflection of the conditions encountered at the La Cygne Generating Station at the time of fieldwork. This report includes a review and compilation of the required information and does not reflect any variations of the subsurface, which may occur between sampling locations. Actual subsurface conditions may vary and the extent of such variations may not become evident without further investigation.

Conclusions drawn by others from the result of this work should recognize the limitation of the methods used. Please note that SCS Engineers does not warrant the work of regulatory agencies or other third parties supplying information used in the assimilation of this report. This report is prepared in accordance with generally accepted environmental engineering and geological practices, within the constraints of the client's directives. It is intended for the exclusive use of Kansas City Power & Light Company for specific application to the La Cygne Generating Station CCR Landfill and Lower AQC Impoundment. No warranties, express or implied, are intended or made.

## APPENDIX A

### FIGURES

#### Figure 1: Site Map


N:\KCP\Projects\Groundwater\DWG\La Cygne\CCR Annual Report\2018\Fig 1 -La Cygne LF LAQC imp.dwg Jan 21, 2019 - 1:25pm Layout Name: Fig 1 By: 4338T\_w



**LEGEND**

CCR UNIT BOUNDARY (APPROXIMATE LIMITS OF CCR LANDFILL AND LOWER AQC IMPOUNDMENT)  
 CCR GROUNDWATER MONITORING SYSTEM WELLS  
 MW-601

- NOTES:**
1. KDHE FACILITY PERMIT AND LANDFILL PERMIT BOUNDARIES VARY FROM THAT SHOWN.
  2. GOOGLE EARTH IMAGE DATED OCTOBER 2014. BOUNDARY AND MONITOR WELL LOCATIONS ARE APPROXIMATE.
  3. BOUNDARY AND MONITOR WELL LOCATIONS ARE PROVIDED BY AECOM.

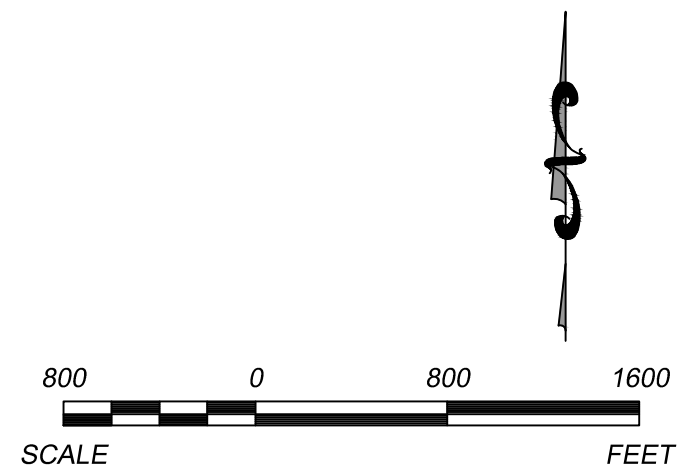

<b>SCS ENGINEERS</b> 8875 W. 110th St. Ste. 100 Overland Park, Kansas 66210 PH: (913) 681-0630 FAX: (913) 681-0012 PROJ. NO. 27217233.1B DSK: BT TCGW	CLIENT <b>KANSAS CITY POWER &amp; LIGHT COMPANY</b> LA CYGNE GENERATING STATION LA CYGNE, KANSAS	SHEET TITLE	CCR LANDFILL & LOWER AQC IMPOUNDMENT CCR GROUNDWATER MONITORING SYSTEM	REV.	DATE	CHK.	BY
		PROJECT TITLE	<b>2018 CCR GROUNDWATER MONITORING          AND CORRECTIVE ACTION REPORT</b>	△	-	-	-
CADD FILE: FIG 1 -LA CYGNE LF LAQC IMP.DWG		DATE: 1/21/19		FIGURE NO. <b>1</b>			

## APPENDIX B

### TABLES

Table 1: Appendix III Detection Monitoring Results

Table 2: Detection Monitoring Field Measurements

**Table 1  
CCR Landfill and Lower AQC Impoundment  
Appendix III Detection Monitoring Results  
KCP&L La Cygne Generating Station**

Well Number	Sample Date	Appendix III Constituents						
		Boron (mg/L)	Calcium (mg/L)	Chloride (mg/L)	Fluoride (mg/L)	pH (S.U.)	Sulfate (mg/L)	Total Dissolved Solids (mg/L)
MW-10	5/23/2018	0.910	54.1	57.9	0.414	7.32	26.7	589
MW-10	11/30/2018	0.914	57.5	55.5	0.300	7.23	17.8	588
MW-13	5/23/2018	0.570	248	14.3	0.227	7.05	1070	1860
MW-13	7/11/2018	*0.533	---	---	*0.181	**7.02	---	---
MW-13	8/16/2018	*0.513	---	---	---	**7.05	---	---
MW-13	11/30/2018	0.698	209	12.8	0.191	6.99	978	1760
MW-14R	5/23/2018	0.682	56.9	5.17	0.287	7.45	54.5	548
MW-14R	11/30/2018	0.812	59.0	5.69	0.231	7.18	65.4	563
MW-15	1/9/2018	---	---	---	---	*7.21	---	---
MW-15	5/23/2018	0.270	105	15.2	0.283	7.10	209	757
MW-15	11/30/2018	0.305	105	12.9	0.206	7.05	191	709
MW-601	1/9/2018	---	---	---	---	*7.41	---	---
MW-601	5/23/2018	1.88	17.6	160	1.73	7.56	<5.00	894
MW-601	7/11/2018	---	---	---	---	*7.43	---	---
MW-601	8/16/2018	---	---	---	---	*7.59	---	---
MW-601	11/30/2018	1.85	17.5	160	1.54	7.58	5.98	924
MW-602	5/23/2018	2.39	22.9	17.6	1.27	7.54	23.9	592
MW-602	11/30/2018	2.32	23.7	16.5	1.09	7.42	24.2	579
MW-801	5/23/2018	2.17	25.6	97.1	1.13	7.42	<5.00	828
MW-801	11/30/2018	2.21	26.8	92.9	0.984	7.34	<5.00	832
MW-802	5/23/2018	2.50	27.5	37.5	1.05	7.34	<5.00	683
MW-802	11/30/2018	2.49	27.8	35.9	0.932	7.38	<5.00	663
MW-803	5/23/2018	2.10	42.9	48.9	0.649	7.46	24.4	606
MW-803	11/30/2018	2.09	44.2	48.7	0.566	7.33	24.5	601
MW-804	5/23/2018	1.72	67.8	30.4	0.501	7.17	21.5	551
MW-804	7/11/2018	*1.67	---	---	*0.449	**7.21	---	---
MW-804	8/16/2018	*1.76	---	---	---	**7.06	---	---
MW-804	11/30/2018	1.75	67.6	32.2	0.378	7.02	19.4	550
MW-805	1/9/2018	---	*439	---	---	**6.76	---	---
MW-805	5/23/2018	0.517	434	424	0.191	6.52	660	1810
MW-805	11/30/2018	0.525	455	471	0.124	6.31	722	2070

\* Verification sample obtained per certified statistical method and Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance, March 2009.

\*\*Extra Sample for Quality Control Validation or per Standard Sampling Procedure

mg/L - milligrams per liter

S.U. - Standard Units

--- Not Sampled

**Table 2  
CCR Landfill and Lower AQC Impoundment  
Detection Monitoring Field Measurements  
KCP&L La Cygne Generating Station**

Well Number	Sample Date	pH (S.U.)	Specific Conductivity (µS)	Temperature (°C)	Turbidity (NTU)	ORP (mV)	DO (mg/L)	***Water Level (ft btoc)	Groundwater Elevation (ft NGVD)
MW-10	5/23/2018	7.32	1090	22.02	0.00	-141	1.89	3.47	871.48
MW-10	11/30/2018	7.23	1090	12.99	0.00	-134	0.00	3.83	871.12
MW-13	5/23/2018	7.05	2180	22.48	0.00	118	3.49	4.13	873.09
MW-13	7/11/2018	**7.02	2330	18.44	0.00	143	1.99	6.48	870.74
MW-13	8/16/2018	**7.05	2090	21.01	0.00	195	1.16	7.56	869.66
MW-13	11/30/2018	6.99	2280	13.35	0.00	62	0.00	5.98	871.24
MW-14R	5/23/2018	7.45	935	20.30	0.00	110	3.49	11.77	867.06
MW-14R	11/30/2018	7.18	1030	13.02	0.00	-61	0.00	11.75	867.08
MW-15	1/9/2018	*7.21	1014	14.96	0.93	NA	NA	10.27	863.61
MW-15	5/23/2018	7.10	1190	17.55	0.00	174	2.93	10.35	863.53
MW-15	11/30/2018	7.05	1240	14.53	0.00	56	0.00	10.35	863.53
MW-601	1/9/2018	*7.41	1412	15.04	1.27	NA	NA	8.82	870.36
MW-601	5/23/2018	7.56	1640	18.46	0.00	-7	2.11	10.26	868.92
MW-601	7/11/2018	*7.43	1750	16.93	0.00	-38	1.72	11.09	868.09
MW-601	8/16/2018	*7.59	1660	22.45	0.00	-91	0.68	11.90	867.28
MW-601	11/30/2018	7.58	1740	11.95	4.60	-60	0.00	9.95	869.23
MW-602	5/23/2018	7.54	1000	19.24	0.00	-11	1.30	3.76	876.13
MW-602	11/30/2018	7.42	1030	12.83	0.00	-48	0.00	4.39	875.50
MW-801	5/23/2018	7.42	1460	21.79	0.00	-31	0.81	1.65	856.00
MW-801	11/30/2018	7.34	1510	12.09	7.70	-100	0.00	2.18	855.47
MW-802	5/23/2018	7.34	1150	21.75	0.00	-87	0.71	2.33	851.14
MW-802	11/30/2018	7.38	1200	11.57	0.60	-64	0.00	1.40	852.07
MW-803	5/23/2018	7.46	1020	21.86	0.00	75	2.50	11.81	843.19
MW-803	11/30/2018	7.33	1110	12.33	1.60	20	0.00	8.55	846.45
MW-804	5/23/2018	7.17	946	25.72	0.00	82	2.74	11.81	843.39
MW-804	7/11/2018	**7.21	964	26.08	0.00	111	1.06	12.34	842.86
MW-804	8/16/2018	**7.06	969	23.08	0.00	-25	0.38	12.85	842.35
MW-804	11/30/2018	7.02	1010	15.14	0.00	-20	0.26	8.29	846.91
MW-805	1/9/2018	**6.76	2441	16.38	0.91	NA	NA	8.18	846.45
MW-805	5/23/2018	6.52	2890	24.89	0.00	79	2.39	7.12	847.51
MW-805	11/30/2018	6.31	3150	14.09	4.90	80	1.36	6.50	848.13

\* Verification sample obtained per certified statistical method and Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance, March 2009.

\*\*Extra Sample for Quality Control Validation or per Standard Sampling Procedure

S.U. - Standard Units

µS - microsiemens

°C - Degrees Celsius

ft btoc - Feet Below Top of Casing

ft NGVD - National Geodetic Vertical Datum (NAVD 88)

NTU - Nephelometric Turbidity Unit

## Appendix C

### Alternative Source Demonstrations

- C.1 Groundwater Monitoring Alternative Source Demonstration  
Report October 2017 Groundwater Monitoring Event
- C.2. Groundwater Monitoring Alternative Source Demonstration  
Report May 2018 Groundwater Monitoring Event

## C.1 Groundwater Monitoring Alternative Source Demonstration Report October 2017 Groundwater Monitoring Event



**CCR GROUNDWATER MONITORING  
ALTERNATIVE SOURCE DEMONSTRATION REPORT  
OCTOBER 2017 GROUNDWATER MONITORING EVENT**

**CCR LANDFILL AND LOWER AQC IMPOUNDMENT  
LA CYGNE GENERATING STATION  
LA CYGNE, KANSAS**

Presented To:

**Kansas City Power & Light Company**


Presented By:

**SCS ENGINEERS**  
7311 West 130th Street, Suite 100  
Overland Park, Kansas 66213  
(913) 681-0030

April 2018  
File No. 27217233.00

## CERTIFICATIONS

I, John R. Rockhold, being a qualified groundwater scientist and licensed Professional Geologist in the State of Kansas, do hereby certify the accuracy of the information in the CCR Groundwater Monitoring Alternative Source Demonstration Report for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station. The Alternative Source Demonstration was prepared by me or under my direct supervision in accordance with generally accepted hydrogeological practices and the local standard of care.

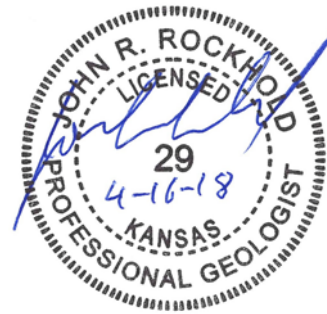

---

John R. Rockhold, P.G.  
SCS Engineers

I, Douglas L. Doerr, being a qualified licensed Professional Engineer in the State of Kansas, do hereby certify the accuracy of the information in the CCR Groundwater Monitoring Alternative Source Demonstration Report for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station. The Alternative Source Demonstration was prepared by me or under my direct supervision in accordance with generally accepted engineering practices and the local standard of care.



---

Douglas L. Doerr, P.E.  
SCS Engineers

## Table of Contents

<b>Section</b>	<b>Page</b>
CERTIFICATIONS.....	i
1 REGULATORY FRAMEWORK .....	1
2 STATISTICAL RESULTS .....	1
3 ALTERNATIVE SOURCE DEMONSTRATION .....	2
3.1 Upgradient Well Location.....	2
3.2 Box and Whiskers Plots .....	2
3.3 Time Series Plots .....	3
4 CONCLUSION.....	3
5 GENERAL COMMENTS .....	3

## Appendices

**Appendix A Figure 1**

**Appendix B Box and Whiskers Plots**

**Appendix C Time Series Plots**

## 1 REGULATORY FRAMEWORK

In accordance with the Coal Combustion Residuals (CCR) Final Rule § 257.94(e)(2), the owner or operator of the CCR unit may demonstrate that a source other than the CCR unit caused the statistically significant increase (SSI) over background levels for a constituent, or that the SSI resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. The owner or operator must complete the written demonstration within 90 days of detecting a SSI over background levels to include obtaining a certification from a qualified professional engineer verifying the accuracy of the information in the report. If a successful demonstration is completed within the 90-day period, the owner or operator of the CCR unit may continue with a detection monitoring program under § 257.94. If a successful demonstration is not completed within the 90-day period, the owner or operator of the CCR unit must initiate an assessment monitoring program as required under § 257.95. The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer.

## 2 STATISTICAL RESULTS

Statistical analysis of monitoring data from the groundwater monitoring system for the CCR Landfill and Lower AQC Impoundment at Kansas City Power & Light Company's (KCP&L) La Cygne Generating Station has been completed in substantial compliance with the "Statistical Method Certification by a Qualified Professional Engineer" document dated October 12, 2017. Groundwater samples were collected and analyzed by October 17, 2017. A statistical analysis was conducted to determine whether there is a SSI over background values for each constituent listed in Appendix III to Part 257-Constituents for Detection Monitoring.

If an SSI is preliminarily identified by the prediction limit analysis, verification retesting will be performed in accordance with the certified statistical method and the resampling plan to verify the result is not due to an error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. Up to two rounds of verification sampling and retesting may be conducted. Verification retesting with a "1 of 2" or "1 of 3" resampling plan is performed by collecting a verification sample(s) and comparing it to the calculated prediction limit. If the resulting concentration of any verification sample is not an SSI, then an SSI has not occurred.

Determinations of SSIs for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station were completed no later than January 15, 2018 and placed into the CCR Operating Record.

The completed statistical evaluation identified one Appendix III constituent pH, below its lower prediction limit in monitoring well MW-601. The prediction limit for pH in monitoring well MW-601 is 7.61 standard units (S.U.). The detection monitoring sample was reported at 7.53 S.U. The first verification sample was collected on January 9, 2018 with a result of 7.41 S.U., which is still below the lower prediction limit. Therefore, in accordance with the Statistical Method Certification, the detection monitoring sample for pH from monitoring well MW-601 exceeds its prediction limit and is a confirmed statistically significant decrease (SSD) below background. An SSD is similar to an SSI in that it indicates a statistically significant difference from background

(i.e., potential impact) when a bracketed (upper and lower) prediction limit is computed such as is done for pH

### 3 ALTERNATIVE SOURCE DEMONSTRATION

An Alternative Source Demonstration (ASD) is a means to provide supporting lines of evidence that something other than a release from a regulated CCR unit caused an SSI or in this case an SSD. For the above identified SSD for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station, there are multiple lines of supporting evidence to indicate the above SSD was not caused by a release from the CCR Landfill and Lower AQC Impoundment. Select multiple lines of supporting evidence are described as follows.

#### 3.1 UPGRADIENT WELL LOCATION

**Figure 1 in Appendix A** shows a potentiometric surface contour map indicating the direction of groundwater flow at and near the CCR Landfill and Lower AQC Impoundment at the time of sampling. Although the groundwater flow directions indicated are for the October 2017 groundwater monitoring event, the flow directions shown are typical. As seen in the map, monitoring well MW-601 is located upgradient from the CCR Landfill and Lower AQC Impoundment indicating the SSD is not caused by a release from the CCR Landfill and Lower AQC Impoundment. This demonstrates that a source other than the CCR Landfill and Lower AQC Impoundment caused the SSD below background levels for pH, or that the SSD resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality.

#### 3.2 BOX AND WHISKERS PLOTS

A commonly accepted method to demonstrate and visualize the distribution of data in a given data set is to construct box and whiskers plots. The basic box plotted graphically locates the median, 25<sup>th</sup> and 75<sup>th</sup> percentiles of the data set; the "whiskers" extend to the minimum and maximum values of the data set. The range between the ends of a box plot represents the Interquartile Range, which can be used as an estimate of spread or variability. The mean is denoted by a "+".

When comparing multiple wells or well groups, box plots for each well can be lined up on the same axes to roughly compare the variability in each well. This may be used as an exploratory screening for the test of homogeneity of variance across multiple wells.

Although an SSD was only identified in upgradient well MW-601, the box and whiskers plot for pH in MW-601 was compared to box and whisker plots for pH in the other groundwater monitoring system wells for the CCR Landfill and Lower AQC Impoundment. The comparison indicates the pH levels in upgradient well MW-601 are within the range of pH levels in both upgradient and downgradient wells across the site. This demonstrates that a source other than the CCR Landfill and Lower AQC Impoundment caused the SSD below background levels for pH, or that the SSD resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. Box and whisker plots are provided in **Appendix B**.

### 3.3 TIME SERIES PLOTS

Time series plots provide a graphical method to view changes in data at a particular well (monitoring point) or wells over time. Time series plots display the variability in concentration levels over time and can be used to indicate possible outliers or data errors. More than one well can be compared on the same plot to look for differences between wells. Non-detect data is plotted as censored data at one-half of the laboratory reporting limit. Time series plots can also be used to examine the data for trends.

Time series plots for the CCR monitoring system wells indicate pH levels for both upgradient and downgradient wells in the monitoring system. The pH level in well MW-601 is within the range of pH levels in both upgradient and downgradient wells across the site. This demonstrates that a source other than the Landfill or Lower AQC Impoundment caused the SSD below background levels for pH, or that the SSD resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. Time series plots are provided in **Appendix C**.

## 4 CONCLUSION

Our opinion is that a sufficient body of evidence is available and presented above to demonstrate that a source other than the CCR Landfill and Lower AQC Impoundment caused the SSD below background levels, or that the SSD resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. Based on the successful ASD, the owner or operator of the CCR Landfill and Lower AQC Impoundment may continue with the detection monitoring program under § 257.94.

## 5 GENERAL COMMENTS

This report has been prepared and reviewed under the direction of a qualified groundwater scientist and qualified professional engineer. Please note that SCS Engineers does not warrant the work of regulatory agencies or other third parties supplying information used in the assimilation of this report. This report is prepared in accordance with generally accepted environmental engineering and geological practices, within the constraints of the client's directives. It is intended for the exclusive use of KCP&L for specific application to the La Cygne Generating Station. No warranties, express or implied, are intended or made.

The signature of the certifying registered geologist and professional engineer on this document represents that to the best of his knowledge, information, and belief in the exercise of his professional judgement in accordance with the standard of practice, it is his professional opinion that the aforementioned information is accurate as of the date of such signature. Any opinion or decisions by him are made on the basis of his experience, qualifications, and professional judgement and are not to be construed as warranties or guaranties. In addition, opinions relating to regulatory, environmental, geologic, geochemical and geotechnical conditions interpretations or other estimates are based on available data, and actual conditions may vary from those encountered at the times and locations where data are obtained, despite the use of due care.

## **Appendix A**

### **Figure 1**

N:\KCP\Projects\Groundwater\DWG\La Cygne\2018\CCR ASD\Fig 1.dwg Apr 16, 2018 - 9:51am Layout Name: Fig 1 By: 4121rcw



**LEGEND**

- CCR UNIT BOUNDARY  
(APPROXIMATE LIMITS OF CCR LANDFILL AND LOWER AQC IMPOUNDMENT)
- MW-601 (870.36) CCR GROUNDWATER MONITORING SYSTEM WELLS (GROUNDWATER ELEVATION)
- 875- GROUNDWATER SURFACE ELEVATIONS (REPRESENTATIVE FOR THIS UNIT)
- MW-803\* INDICATES WELL NOT USED IN POTENTIOMETRIC SURFACE MAP CREATION

**NOTES:**

1. KDHE FACILITY PERMIT AND LANDFILL PERMIT BOUNDARIES VARY FROM THAT SHOWN.
2. GOOGLE EARTH IMAGE DATED OCTOBER 2014. BOUNDARY AND MONITOR WELL LOCATIONS ARE APPROXIMATE.
3. BOUNDARY AND MONITOR WELL LOCATIONS ARE PROVIDED BY AECOM.



REV.	DATE	BY	CHK.
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			


CLIENT	KANSAS CITY POWER & LIGHT COMPANY LA CYGNE GENERATING STATION LA CYGNE, KANSAS
PROJECT TITLE	CCR ALTERNATIVE SOURCE DEMONSTRATION
SHEET TITLE	POTENTIOMETRIC SURFACE MAP (OCT 2017) CCR LANDFILL & LOWER AQC IMPOUNDMENT
CLIENT	SCS ENGINEERS 7311 W. 130th St., Ste. 100 Overland Park, Kansas 66213 PH: (913) 681-0030 FAX: (913) 681-0012 DWN. BY: RCW    CHK. BY: JRR    D/A R/W BY: JRR 2/27/2018    PROD. DATE: JRR
CADD FILE:	LA CYGNE LF LAQC IMP_CCR ASD_FIG 1.DWG
DATE:	4/16/18
FIGURE NO.	1



## **Appendix B**

### **Box and Whiskers Plots**

### Box & Whiskers Plot

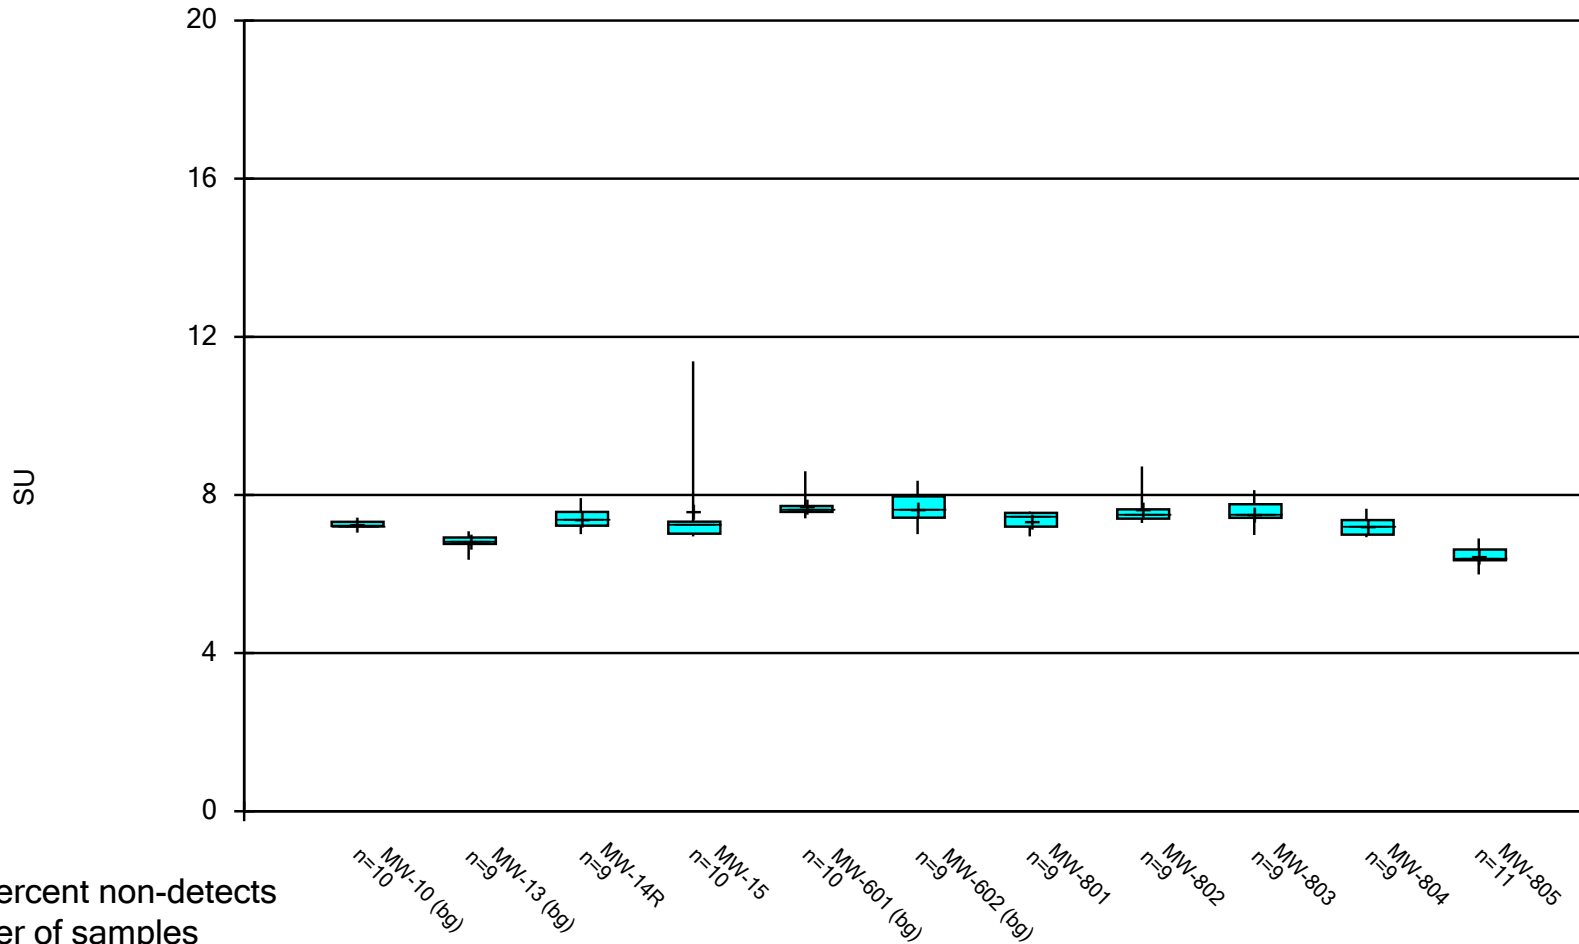

%nds = percent non-detects  
n = number of samples  
bg = background/upgradinet data

Constituent: pH Analysis Run 3/6/2018 3:36 PM View: LF LAQC III

LaCygne Client: SCS Engineers Data: LaC GW Data

The basic box plot graphically locates the median, 25th and 75th percentiles of the data set; the "whiskers" extend to the minimum and maximum values of the data set. The range between the ends of a box plot represents the Interquartile Range. The mean is denoted by a "+".

# Box & Whiskers Plot

Constituent: pH (SU) Analysis Run 3/6/2018 3:36 PM View: LF LAQC III

LaCygne Client: SCS Engineers Data: LaC GW Data

	MW-10 (bg)	MW-13 (bg)	MW-14R	MW-15	MW-601 (bg)	MW-602 (bg)	MW-801	MW-802	MW-803
6/6/2016	7.33								
6/7/2016							7.47	7.46	
6/8/2016									
6/9/2016		6.88	7.42	7.31	7.66				7.48
6/10/2016						7.01			
8/9/2016				7.23	7.72	7.64	7.48		
8/10/2016								7.52	
8/11/2016	7.26	6.78	7.26						
8/12/2016									7.51
10/11/2016							7.32	7.34	
10/12/2016	7.33			7.28					
10/13/2016		6.95	7.51		7.71	7.34			6.99
12/6/2016							7.14	7.48	7.48
12/7/2016				7.02	7.61				
12/9/2016	7.22		7.42			8.15			
12/13/2016		6.36							
2/6/2017									
2/7/2017				7.28			7.58	7.67	
2/8/2017	7.21				8.6	8.36			8.12
2/9/2017			7.92						
2/10/2017		7.08							
4/5/2017				11.38				8.72	
4/6/2017	7.23	6.86			7.61		7.26		
4/7/2017			7.34			7.51			7.36
6/13/2017								7.6	7.98
6/14/2017				7.34			6.95		
6/15/2017	7.31	6.8	7.19		7.62	7.77			
8/7/2017							7.29		
8/8/2017		6.74							7.52
8/9/2017					7.72		7.51		
8/10/2017	7.29		7.01	7.02		7.56			
10/3/2017				6.95					
10/4/2017	7.23						7.58	7.58	7.55
10/5/2017		6.9	7.63			7.78			
10/6/2017					7.53				
12/12/2017	7.19								
1/9/2018				7.21	7.41				
<b>Median</b>	7.25	6.86	7.42	7.26	7.64	7.64	7.47	7.52	7.51
<b>LowerQ.</b>	7.22	6.76	7.23	7.02	7.57	7.43	7.2	7.4	7.42
<b>UpperQ.</b>	7.32	6.93	7.57	7.33	7.72	7.97	7.55	7.64	7.77
<b>Min</b>	7.19	6.36	7.01	6.95	7.41	7.01	6.95	7.29	6.99
<b>Max</b>	7.33	7.08	7.92	11.4	8.6	8.36	7.58	8.72	8.12
<b>Mean</b>	7.26	6.82	7.41	7.6	7.72	7.68	7.37	7.63	7.55

# Box & Whiskers Plot

Constituent: pH (SU) Analysis Run 3/6/2018 3:36 PM View: LF LAQC III  
LaCygne Client: SCS Engineers Data: LaC GW Data

	MW-804	MW-805
6/6/2016		
6/7/2016		6.52
6/8/2016	7.13	
6/9/2016		
6/10/2016		
8/9/2016		
8/10/2016	7.32	6.35
8/11/2016		
8/12/2016		
10/11/2016	7.2	6.36
10/12/2016		
10/13/2016		
12/6/2016		6.36
12/7/2016	6.93	
12/9/2016		
12/13/2016		
2/6/2017		6.62
2/7/2017	7.41	
2/8/2017		
2/9/2017		
2/10/2017		
4/5/2017	7.65	6.9
4/6/2017		
4/7/2017		
6/13/2017	7.22	6.43
6/14/2017		
6/15/2017		
8/7/2017		
8/8/2017	7.06	6.49
8/9/2017		
8/10/2017		
10/3/2017		
10/4/2017		
10/5/2017	6.93	5.99
10/6/2017		
12/12/2017		6.35
1/9/2018		6.76
Median	7.2	6.43
LowerQ.	7	6.35
UpperQ.	7.37	6.62
Min	6.93	5.99
Max	7.65	6.9
Mean	7.21	6.47

# Box & Whiskers Plot


LaCygne Client: SCS Engineers Data: LaC GW Data Printed 3/6/2018, 3:36 PM

<u>Constituent</u>	<u>Well</u>	<u>N</u>	<u>Mean</u>	<u>Std. Dev.</u>	<u>Std. Err.</u>	<u>Median</u>	<u>Min.</u>	<u>Max.</u>	<u>%NDs</u>
pH (SU)	MW-10 (bg)	10	7.26	0.0516	0.0163	7.25	7.19	7.33	0
pH (SU)	MW-13 (bg)	9	6.82	0.199	0.0662	6.86	6.36	7.08	0
pH (SU)	MW-14R	9	7.41	0.263	0.0878	7.42	7.01	7.92	0
pH (SU)	MW-15	10	7.6	1.33	0.422	7.26	6.95	11.4	0
pH (SU)	MW-601 (bg)	10	7.72	0.324	0.102	7.64	7.41	8.6	0
pH (SU)	MW-602 (bg)	9	7.68	0.405	0.135	7.64	7.01	8.36	0
pH (SU)	MW-801	9	7.37	0.216	0.072	7.47	6.95	7.58	0
pH (SU)	MW-802	9	7.63	0.427	0.142	7.52	7.29	8.72	0
pH (SU)	MW-803	9	7.55	0.33	0.11	7.51	6.99	8.12	0
pH (SU)	MW-804	9	7.21	0.232	0.0774	7.2	6.93	7.65	0
pH (SU)	MW-805	11	6.47	0.241	0.0726	6.43	5.99	6.9	0

## **Appendix C**

### **Time Series Plots**

# Time Series

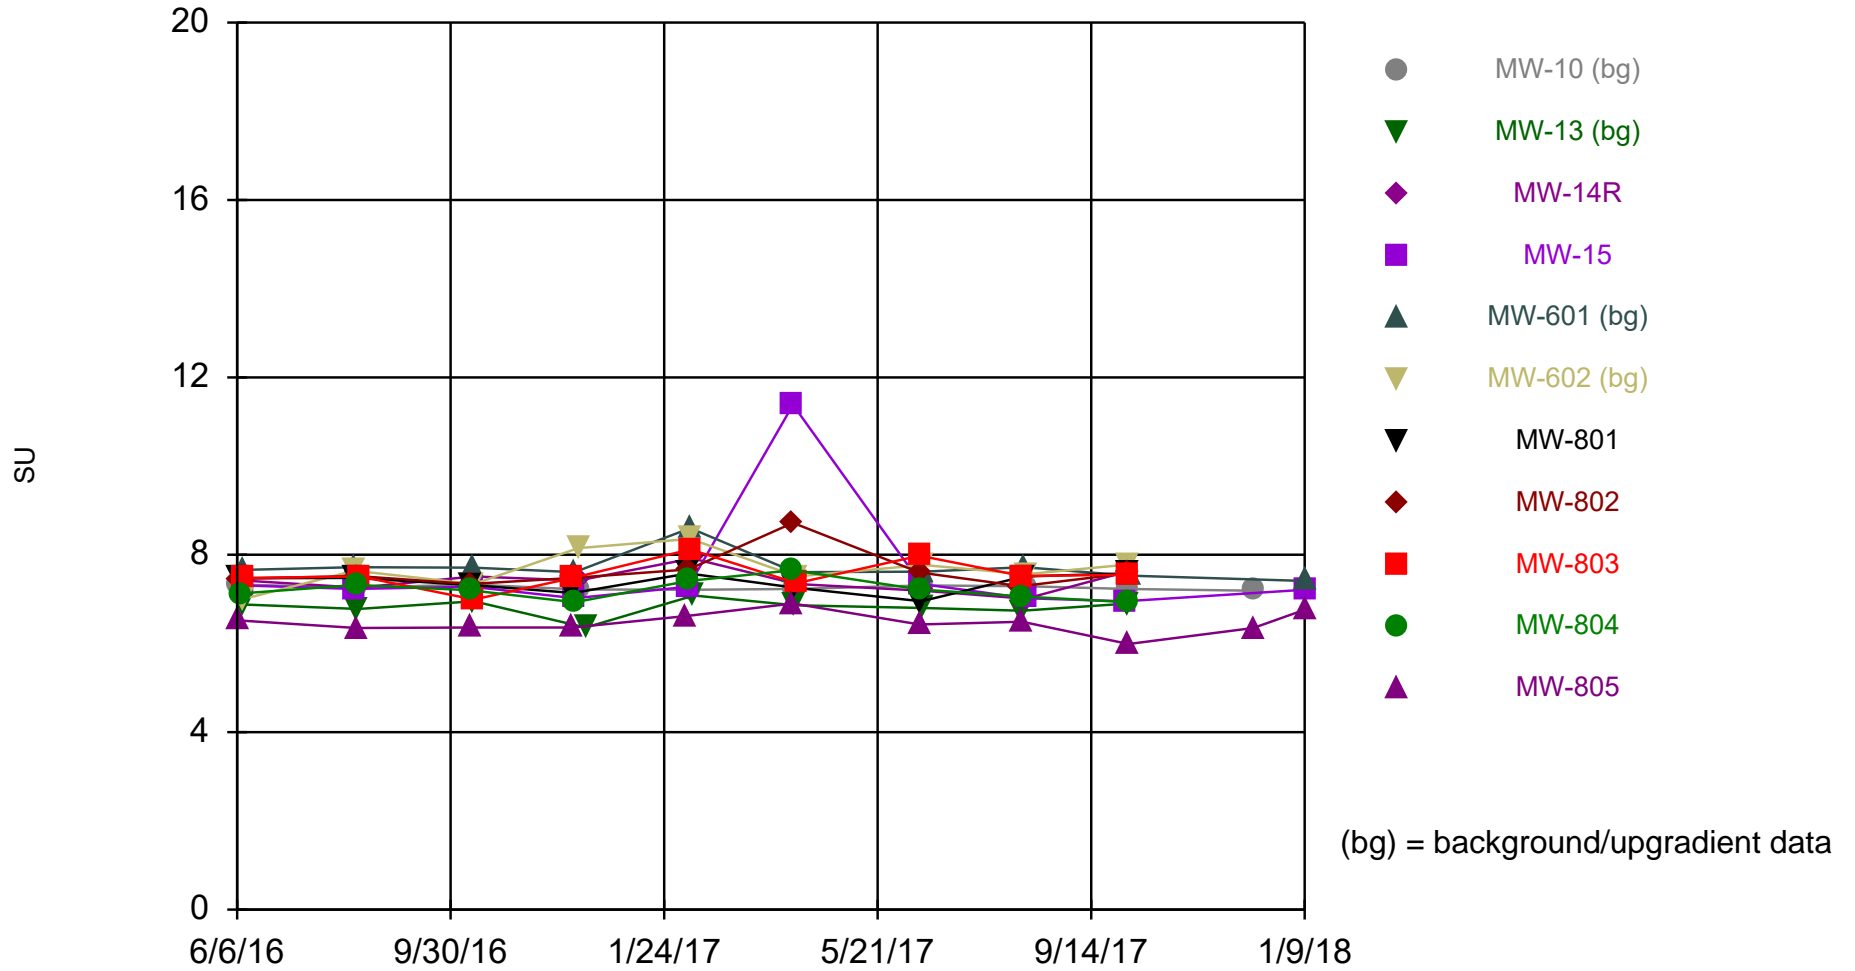

Constituent: pH Analysis Run 3/6/2018 3:39 PM View: LF LAQC III  
LaCygne Client: SCS Engineers Data: LaC GW Data

# Time Series

Constituent: pH (SU) Analysis Run 3/6/2018 3:40 PM View: LF LAQC III

LaCygne Client: SCS Engineers Data: LaC GW Data

	MW-10 (bg)	MW-13 (bg)	MW-14R	MW-15	MW-601 (bg)	MW-602 (bg)	MW-801	MW-802	MW-803
6/6/2016	7.33								
6/7/2016							7.47	7.46	
6/8/2016									
6/9/2016		6.88	7.42	7.31	7.66				7.48
6/10/2016						7.01			
8/9/2016				7.23	7.72	7.64	7.48		
8/10/2016								7.52	
8/11/2016	7.26	6.78	7.26						
8/12/2016									7.51
10/11/2016							7.32	7.34	
10/12/2016	7.33			7.28					
10/13/2016		6.95	7.51		7.71	7.34			6.99
12/6/2016							7.14	7.48	7.48
12/7/2016				7.02	7.61				
12/9/2016	7.22		7.42			8.15			
12/13/2016		6.36							
2/6/2017									
2/7/2017				7.28			7.58	7.67	
2/8/2017	7.21				8.6	8.36			8.12
2/9/2017			7.92						
2/10/2017		7.08							
4/5/2017				11.38				8.72	
4/6/2017	7.23	6.86			7.61		7.26		
4/7/2017			7.34			7.51			7.36
6/13/2017								7.6	7.98
6/14/2017				7.34			6.95		
6/15/2017	7.31	6.8	7.19		7.62	7.77			
8/7/2017							7.29		
8/8/2017		6.74							7.52
8/9/2017					7.72		7.51		
8/10/2017	7.29		7.01	7.02		7.56			
10/3/2017				6.95					
10/4/2017	7.23						7.58	7.58	7.55
10/5/2017		6.9	7.63			7.78			
10/6/2017					7.53				
12/12/2017	7.19								
1/9/2018				7.21	7.41				



# Time Series

Constituent: pH (SU) Analysis Run 3/6/2018 3:40 PM View: LF LAQC III  
LaCygne Client: SCS Engineers Data: LaC GW Data

---

	MW-804	MW-805
6/6/2016		
6/7/2016		6.52
6/8/2016	7.13	
6/9/2016		
6/10/2016		
8/9/2016		
8/10/2016	7.32	6.35
8/11/2016		
8/12/2016		
10/11/2016	7.2	6.36
10/12/2016		
10/13/2016		
12/6/2016		6.36
12/7/2016	6.93	
12/9/2016		
12/13/2016		
2/6/2017		6.62
2/7/2017	7.41	
2/8/2017		
2/9/2017		
2/10/2017		
4/5/2017	7.65	6.9
4/6/2017		
4/7/2017		
6/13/2017	7.22	6.43
6/14/2017		
6/15/2017		
8/7/2017		
8/8/2017	7.06	6.49
8/9/2017		
8/10/2017		
10/3/2017		
10/4/2017		
10/5/2017	6.93	5.99
10/6/2017		
12/12/2017		6.35
1/9/2018		6.76

## C.2. Groundwater Monitoring Alternative Source Demonstration Report May 2018 Groundwater Monitoring Event

**CCR GROUNDWATER MONITORING  
ALTERNATIVE SOURCE DEMONSTRATION REPORT  
MAY 2018 GROUNDWATER MONITORING EVENT**

**CCR LANDFILL AND LOWER AQC IMPOUNDMENT  
LA CYGNE GENERATING STATION  
LA CYGNE, KANSAS**

Presented To:

**Kansas City Power & Light Company**

Presented By:

**SCS ENGINEERS**

8575 West 110th Street, Suite 100

Overland Park, Kansas 66210

(913) 681-0030

December 2018

File No. 27217233.18

## CERTIFICATIONS

I, John R. Rockhold, being a qualified groundwater scientist and licensed Professional Geologist in the State of Kansas, do hereby certify the accuracy of the information in the CCR Groundwater Monitoring Alternative Source Demonstration Report for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station. The Alternative Source Demonstration was prepared by me or under my direct supervision in accordance with generally accepted hydrogeological practices and the local standard of care.



---

John R. Rockhold, P.G.

SCS Engineers

I, Douglas L. Doerr, being a qualified licensed Professional Engineer in the State of Kansas, do hereby certify the accuracy of the information in the CCR Groundwater Monitoring Alternative Source Demonstration Report for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station. The Alternative Source Demonstration was prepared by me or under my direct supervision in accordance with generally accepted engineering practices and the local standard of care.



---

Douglas L. Doerr, P.E.

SCS Engineers

## Table of Contents

<b>Section</b>	<b>Page</b>
CERTIFICATIONS.....	i
1 Regulatory Framework .....	1
2 Statistical Results.....	1
3 Alternative Source Demonstration.....	2
3.1 Upgradient Well Location.....	2
3.2 Box and Whiskers Plots.....	3
3.3 Time Series Plots.....	3
4 Conclusion .....	4
5 General Comments.....	4

## Appendices

- Appendix A Figure 1**
- Appendix B Box and Whiskers Plots**
- Appendix C Time Series Plots**

## 1 REGULATORY FRAMEWORK

Certain owners or operators of Coal Combustion Residuals (CCR) units are required to complete groundwater monitoring activities to evaluate whether a release from the unit has occurred. Included in the activities is the completion of a statistical analysis of the groundwater quality data as prescribed in § 257.93(h) of the CCR Final Rule. If the initial analysis indicates a statistically significant increase (SSI) over background levels, the owner or operator may perform an alternate source demonstration (ASD). In accordance with § 257.94(e)(2), the owner or operator of the CCR unit may demonstrate that a source other than the CCR unit caused the SSI over background levels for a constituent, or that the SSI resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. The owner or operator must complete the written demonstration within 90 days of detecting a SSI over background levels to include obtaining a certification from a qualified professional engineer verifying the accuracy of the information in the report. If a successful demonstration is completed within the 90-day period, the owner or operator of the CCR unit may continue with a detection monitoring program under § 257.94. If a successful demonstration is not completed within the 90-day period, the owner or operator of the CCR unit must initiate an assessment monitoring program as required under § 257.95. The owner or operator must also include the demonstration in the annual groundwater monitoring and corrective action report required by § 257.90(e), in addition to the certification by a qualified professional engineer.

## 2 STATISTICAL RESULTS

Statistical analysis of monitoring data from the groundwater monitoring system for the CCR Landfill and Lower AQC Impoundment multi-unit groundwater monitoring system at the La Cygne Generating Station has been completed in substantial compliance with the “Statistical Method Certification by A Qualified Professional Engineer” dated October 12, 2017. Detection monitoring groundwater samples were collected on May 23, 2018. Review and validation of the results from the May 2018 Detection Monitoring Event was completed on June 15, 2018, which constitutes completion and finalization of detection monitoring laboratory analyses. A statistical analysis was then conducted to determine whether there was a statistically significant increase (SSI) over background values for each constituent listed in Appendix III to Part 257-Constituents for Detection Monitoring. Two rounds of verification sampling were conducted for certain constituents on July 11, 2018 and August 16, 2018.

If an SSI is preliminarily identified by the prediction limit analysis, verification retesting is performed in accordance with the certified statistical method and the resampling plan to verify the result is not due to an error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. Up to two rounds of verification sampling and retesting may be conducted. Verification retesting with a “1 of 2” or “1 of 3” resampling plan is performed by collecting a verification sample(s) and comparing it to the calculated prediction limit. If the resulting concentration of any verification sample is not above the prediction limit, then an SSI is not confirmed.

Determinations of SSIs for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station were completed September 12, 2018 and placed into the CCR Operating Record.

The completed statistical evaluation identified Appendix III constituent, boron, above its respective prediction limit in monitoring wells MW-13 and MW-804, and pH below its respective lower prediction limit in monitoring well MW-601.

The prediction limit for boron in upgradient monitoring well MW-13 is 0.491 milligrams per liter (mg/L). The detection monitoring sample was reported at 0.57 mg/L. The first verification re-sample was collected on July 11, 2018 with a result of 0.533 mg/L. The second verification re-sample was collected on August 16, 2018 with a result of 0.513 mg/L.

The prediction limit for boron in monitoring well MW-804 is 1.65 mg/L. The detection monitoring sample was reported at 1.72 mg/L. The first verification re-sample was collected on July 11, 2018 with a result of 1.67 mg/L. The second verification re-sample was collected on August 16, 2018 with a result of 1.76 mg/L.

Therefore, in accordance with the Statistical Method Certification, the detection monitoring sample for boron from monitoring wells MW-13 and MW-804 exceed their respective prediction limits and are confirmed statistically significant increases (SSIs) over background.

The lower prediction limit for pH in upgradient monitoring well MW-601 is 7.61 standard units (S.U.). The detection monitoring sample was reported at 7.56 S.U. The first verification re-sample was collected on July 11, 2018 with a result of 7.43 S.U. The second verification re-sample was collected on August 16, 2018 with a result of 7.59 S.U.

Therefore, in accordance with the Statistical Method Certification, the detection monitoring sample for pH from monitoring wells MW-601 was below its lower prediction limit and is a confirmed statistically significant decrease (SSDs) below background.

**Determination: A statistical evaluation was completed for all Appendix III detection monitoring constituents in accordance with the certified statistical method. The statistical evaluation identified two SSIs above the background prediction limit for boron in upgradient monitoring well MW-13 and downgradient monitoring well MW-804. Additionally, the statistical evaluation identified one statistically significant decrease (SSD) below the background lower prediction limit for pH in upgradient monitoring well MW-601.**

### 3 ALTERNATIVE SOURCE DEMONSTRATION

An Alternative Source Demonstration is a means to provide supporting lines of evidence that something other than a release from a regulated CCR unit caused an SSI or in this case for pH, an SSD. For the above identified SSIs and SSD for the CCR Landfill and Lower AQC Impoundment at the La Cygne Generating Station, there are multiple lines of supporting evidence to indicate they are not caused by a release from the CCR Landfill and Lower AQC Impoundment. Select multiple lines of supporting evidence are described as follows.

#### 3.1 UPGRADIENT WELL LOCATION

**Figure 1 in Appendix A** shows a potentiometric surface contour map indicating the direction of groundwater flow at and near the CCR Landfill and Lower AQC Impoundment at the time of sampling. The groundwater flow directions indicated are for the May 2018 groundwater monitoring event and are typical flow directions for this unit. As seen in the map, monitoring wells MW-601 and MW-13 are located upgradient from the CCR Landfill and Lower AQC Impoundment indicating the SSD for pH and the SSI for boron are not caused by a release from the CCR Landfill and Lower AQC Impoundment. This demonstrates that a source other than the CCR Landfill and Lower AQC Impoundment caused the SSD below background levels for pH and the SSI above background levels for boron, or that the

respective SSD and SSI resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality.

## 3.2 BOX AND WHISKERS PLOTS

A commonly accepted method to demonstrate and visualize the distribution of data in a given data set is to construct box and whiskers plots. The basic box plotted graphically locates the median, 25<sup>th</sup> and 75<sup>th</sup> percentiles of the data set; the "whiskers" extend to the minimum and maximum values of the data set. The range between the ends of a box plot represents the Interquartile Range, which can be used as an estimate of spread or variability. The mean is denoted by a "+".

When comparing multiple wells or well groups, box plots for each well can be lined up on the same axes to roughly compare the variability in each well. This may be used as an exploratory screening for the test of homogeneity of variance across multiple wells.

Box and whiskers plots were prepared for pH and boron for upgradient wells MW-601, MW-602, and MW-13 and downgradient well MW-804. Although the SSD was only identified in upgradient well MW-601, the box and whiskers plot shows that it is well within the overall pH range for upgradient wells (MW-601, MW-602, and MW-13). The comparison indicates the pH levels in upgradient well MW-601 are within the range of pH levels in upgradient wells. This demonstrates that a source other than the CCR Landfill and Lower AQC Impoundment caused the SSD below background levels for pH, or that the SSD resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality.

An SSI was identified for boron in both upgradient well MW-13 and downgradient well MW-804. However, when plotted along with the other upgradient wells (MW-601 and MW-602), the concentration of boron identified as an SSI in MW-804 is below the concentrations of boron identified in upgradient wells MW-601 and MW-602. The comparison indicates the boron levels in downgradient well MW-804 are within the range of boron concentrations in upgradient wells. This demonstrates that a source other than the CCR Landfill and Lower AQC Impoundment caused the SSI above background levels for boron, or that the SSI resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality.

Box and whiskers plots are provided in **Appendix B**.

## 3.3 TIME SERIES PLOTS

Time series plots provide a graphical method to view changes in data at a particular well (monitoring point) or wells over time. Time series plots display the variability in concentration levels over time and can be used to indicate possible outliers or data errors. More than one well can be compared on the same plot to look for differences between wells. Non-detect data is plotted as censored data at one-half of the laboratory reporting limit. Time series plots can also be used to examine the data for trends.

Time series plots for the CCR monitoring system upgradient wells MW-13, MW-601, and MW-602 and downgradient well MW-804 indicate boron levels for MW-13 and MW-804 and pH levels for MW-601 are within the range of boron and pH levels in upgradient wells. This demonstrates that a source other than the Landfill or Lower AQC Impoundment caused the boron SSIs and the pH SSD, or that the SSIs



and SSD resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality.

Time series plots are provided in **Appendix C**.

## 4 CONCLUSION

Our opinion is that a sufficient body of evidence is available and presented above to demonstrate that a source other than the CCR Landfill and Lower AQC Impoundment caused the SSIs for boron and SSD for pH, or that the SSIs and the SSD resulted from error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality. Based on the successful ASD, the owner or operator of the CCR Landfill and Lower AQC Impoundment may continue with the detection monitoring program under § 257.94.

## 5 GENERAL COMMENTS

This report has been prepared and reviewed under the direction of a qualified groundwater scientist and qualified professional engineer. Please note that SCS Engineers does not warrant the work of regulatory agencies or other third parties supplying information used in the assimilation of this report. This report is prepared in accordance with generally accepted environmental engineering and geological practices, within the constraints of the client's directives. It is intended for the exclusive use of KCP&L for specific application to the La Cygne Generating Station. No warranties, express or implied, are intended or made.

The signature of the certifying registered geologist and professional engineer on this document represents that to the best of their knowledge, information, and belief in the exercise of his professional judgement in accordance with the standard of practice, it is his professional opinion that the aforementioned information is accurate as of the date of such signature. Any opinion or decisions by them are made on the basis of his experience, qualifications, and professional judgement and are not to be construed as warranties or guaranties. In addition, opinions relating to regulatory, environmental, geologic, geochemical and geotechnical conditions interpretations or other estimates are based on available data, and actual conditions may vary from those encountered at the times and locations where data are obtained, despite the use of due care.

## **Appendix A**

### **Figure 1**

N:\KCP\Projects\Groundwater\DWG\La Cygne\2018\GW\La Cygne LF LAQC Imp & UAQC Fig 1\_MAY 2018.dwg Dec 10, 2018 - 12:22pm Layout Name: Fig 1 LAQC By: 4338T\_w



**LEGEND**

- CCR UNIT BOUNDARY (APPROXIMATE LIMITS OF CCR LANDFILL AND LOWER AQC IMPOUNDMENT)
- MW-601 (868.92) CCR GROUNDWATER MONITORING SYSTEM WELLS (GROUNDWATER ELEVATION)
- 875- GROUNDWATER POTENTIOMETRIC SURFACE ELEVATIONS (REPRESENTATIVE FOR THIS UNIT)

**NOTES:**

1. KDHE FACILITY PERMIT AND LANDFILL PERMIT BOUNDARIES VARY FROM THAT SHOWN.
2. GOOGLE EARTH IMAGE DATED OCTOBER 2014. BOUNDARY AND MONITOR WELL LOCATIONS ARE APPROXIMATE.
3. BOUNDARY AND MONITOR WELL LOCATIONS ARE PROVIDED BY AECOM.




SHEET TITLE	POTENTIOMETRIC SURFACE MAP (MAY 2018)	REV.	DATE	CHK.	BY
	CCR LANDFILL & LOWER AQC IMPOUNDMENT	△	-	-	-
PROJECT TITLE	CCR GROUNDWATER 2018	△	-	-	-
CLIENT	KANSAS CITY POWER & LIGHT COMPANY LA CYGNE GENERATING STATION LA CYGNE, KANSAS	△	-	-	-
SCS ENGINEERS 7311 W. 130th St. Ste. 100 Overland Park, Kansas 66213 PH: (913) 681-0630 FAX: (913) 681-0012	DWN. BY: RCW	CHK. BY: JRR	Q/A RW BY: JRR	PROJ. MGR. BY: JRR	
	PROJ. NO. 27217233.00	CHK. BY: JRR			
CADD FILE: LA CYGNE LF LAQC IMP & UAQC FIG 1_MAY 2018.dwg	DATE: 6/21/18				
FIGURE NO.	1				

## **Appendix B**


### **Box and Whiskers Plots**

### Box & Whiskers Plot

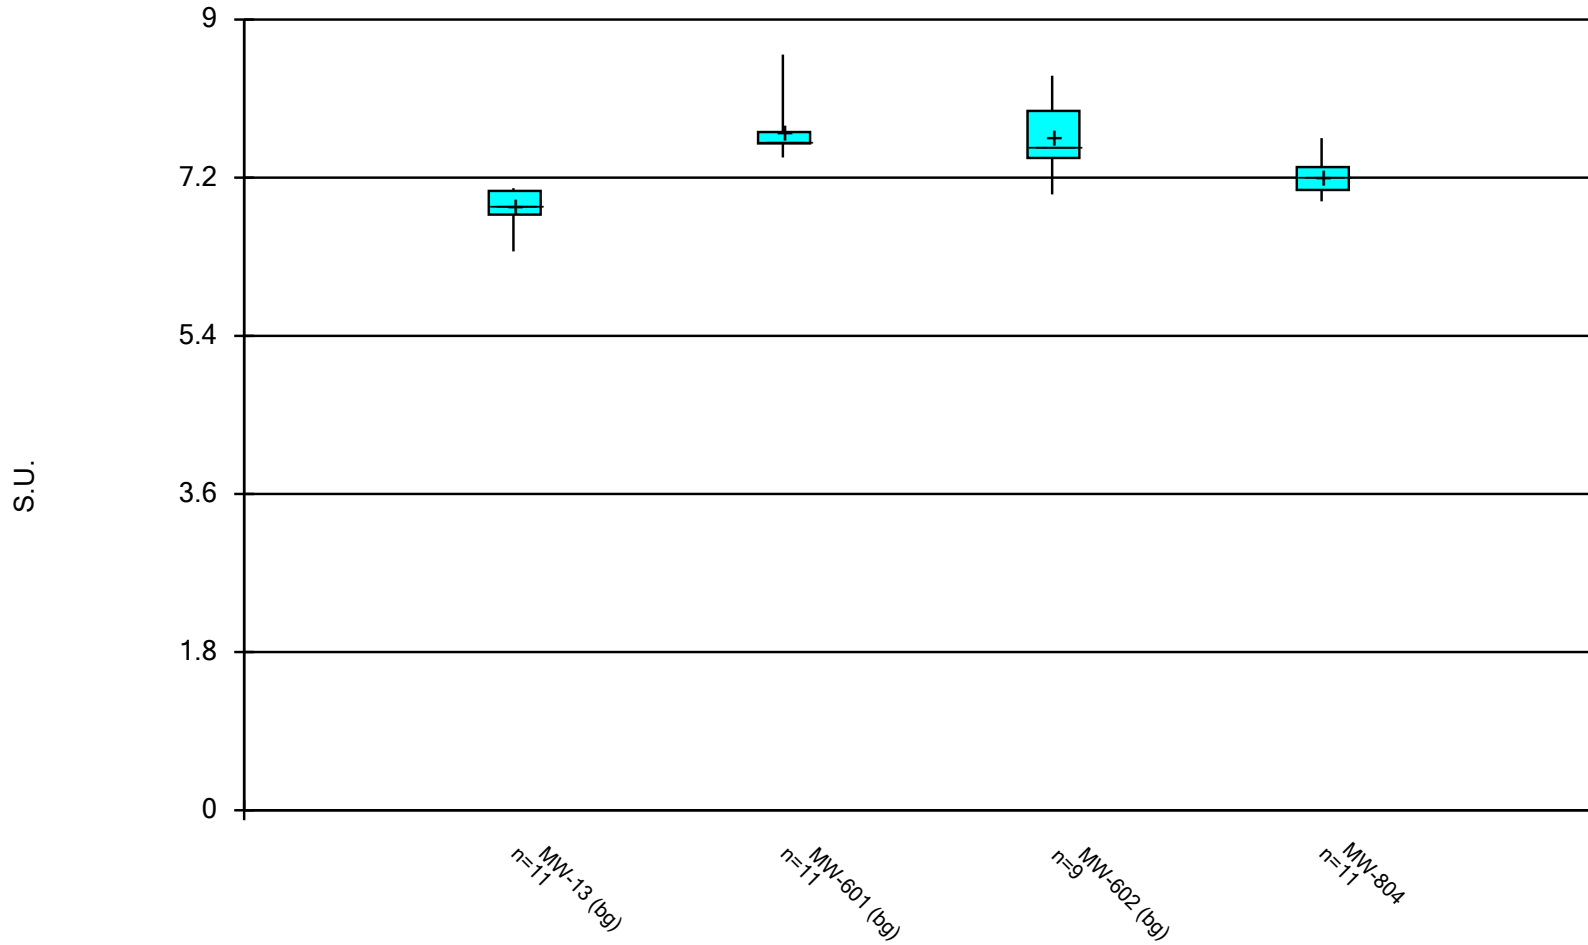

Constituent: pH Analysis Run 9/10/2018 11:29 AM View: LF LAQC III  
LaCygne Client: SCS Engineers Data: LaC GW Data

### Box & Whiskers Plot

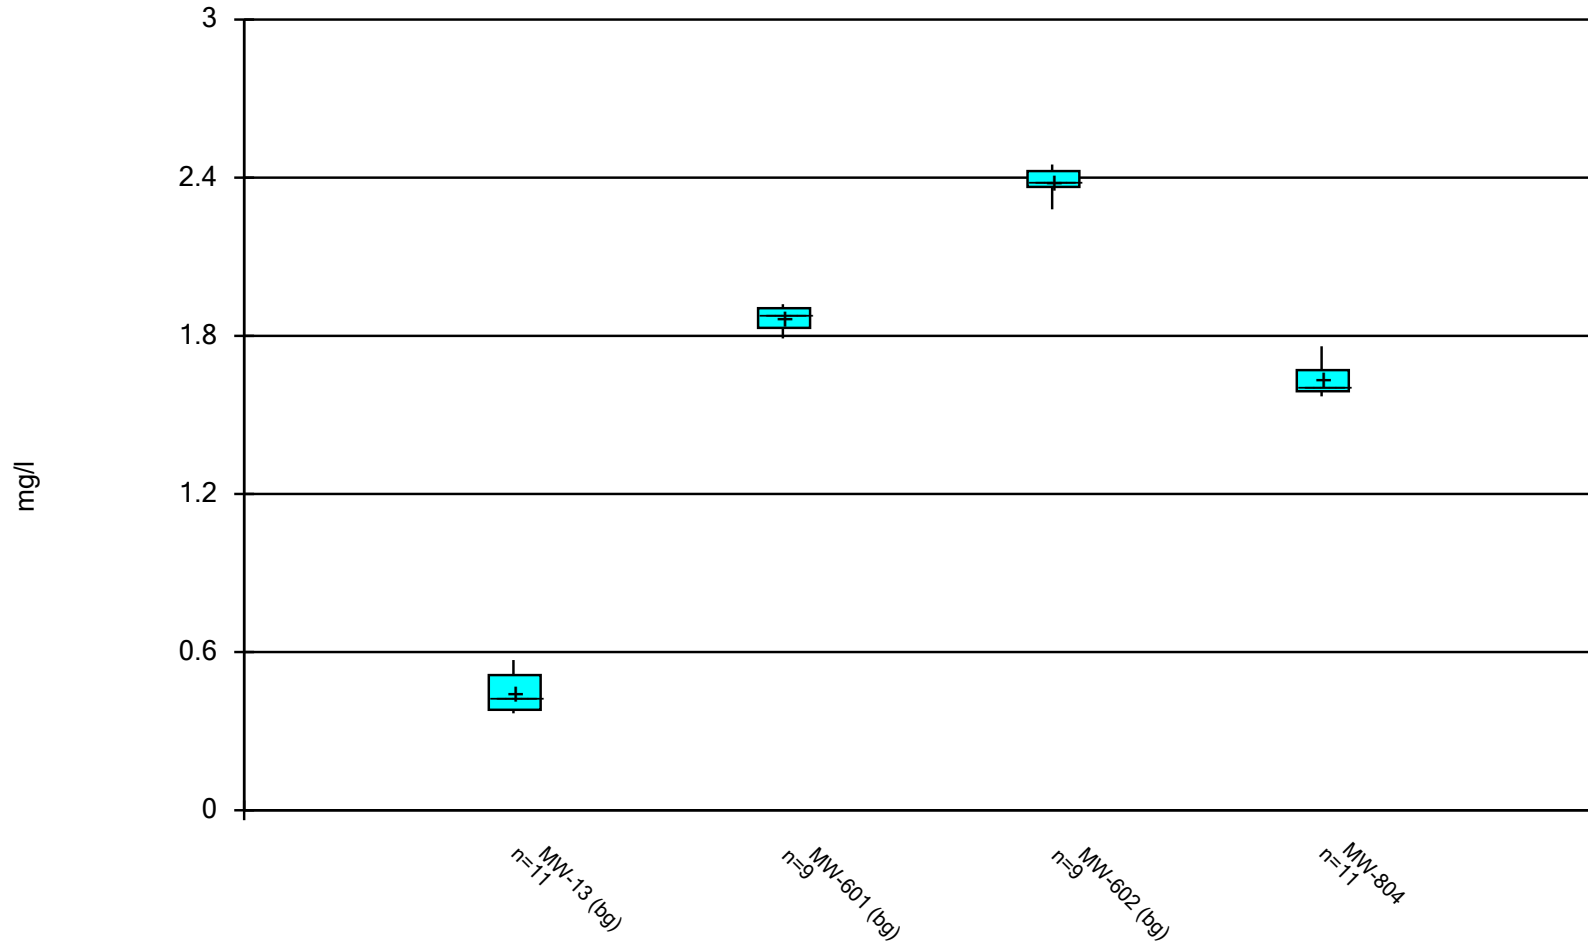

Constituent: BORON Analysis Run 9/10/2018 11:29 AM View: LF LAQC III  
LaCygne Client: SCS Engineers Data: LaC GW Data

# Box & Whiskers Plot

LaCygne Client: SCS Engineers Data: LaC GW Data Printed 9/10/2018, 11:32 AM


<u>Constituent</u>	<u>Well</u>	<u>N</u>	<u>Mean</u>	<u>Std. Dev.</u>	<u>Std. Err.</u>	<u>Median</u>	<u>Min.</u>	<u>Max.</u>	<u>%NDs</u>
BORON (mg/l)	MW-13 (bg)	11	0.445	0.07	0.0211	0.422	0.368	0.57	0
BORON (mg/l)	MW-601 (bg)	9	1.87	0.0447	0.0149	1.88	1.79	1.92	0
BORON (mg/l)	MW-602 (bg)	9	2.39	0.0518	0.0173	2.39	2.28	2.45	0
BORON (mg/l)	MW-804	11	1.63	0.0619	0.0187	1.61	1.57	1.76	0
pH (S.U.)	MW-13 (bg)	11	6.87	0.207	0.0624	6.88	6.36	7.08	0
pH (S.U.)	MW-601 (bg)	11	7.71	0.306	0.0924	7.62	7.43	8.6	0
pH (S.U.)	MW-602 (bg)	9	7.65	0.405	0.135	7.56	7.01	8.36	0
pH (S.U.)	MW-804	11	7.21	0.194	0.0585	7.2	6.93	7.65	0

## **Appendix C**

### **Time Series Plots**



### Time Series

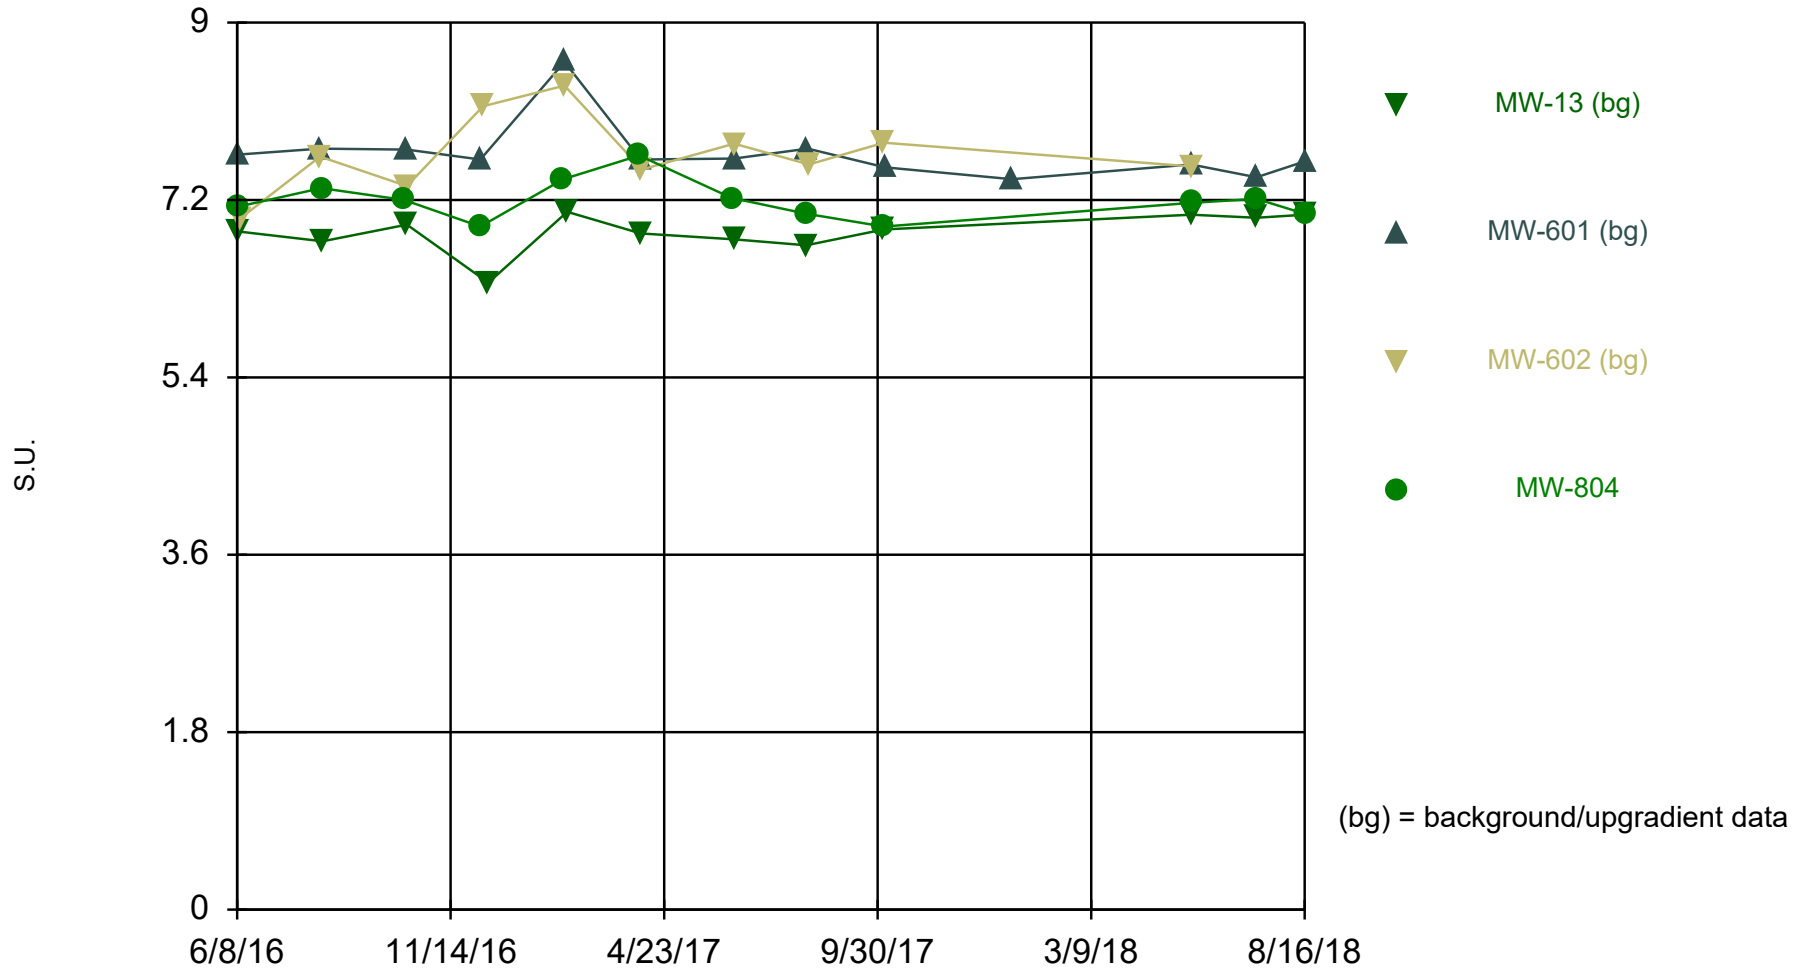

Constituent: pH Analysis Run 11/12/2018 4:38 PM View: LF LAQC III  
LaCygne Client: SCS Engineers Data: LaC GW Data


# Time Series

Constituent: pH (S.U.) Analysis Run 11/12/2018 4:40 PM View: LF LAQC III

LaCygne Client: SCS Engineers Data: LaC GW Data

	MW-13 (bg)	MW-601 (bg)	MW-602 (bg)	MW-804
6/8/2016				7.13
6/9/2016	6.88	7.66		
6/10/2016			7.01	
8/9/2016		7.72	7.64	
8/10/2016				7.32
8/11/2016	6.78			
10/11/2016				7.2
10/13/2016	6.95	7.71	7.34	
12/7/2016		7.61		6.93
12/9/2016			8.15	
12/13/2016	6.36			
2/7/2017				7.41
2/8/2017		8.6	8.36	
2/10/2017	7.08			
4/5/2017				7.65
4/6/2017	6.86	7.61		
4/7/2017			7.51	
6/13/2017				7.22
6/15/2017	6.8	7.62	7.77	
8/8/2017	6.74			7.06
8/9/2017		7.72		
8/10/2017			7.56	
10/5/2017	6.9		7.78	6.93
10/6/2017		7.53		
1/9/2018		7.41		
5/23/2018	7.05	7.56	7.54	7.17
7/11/2018	7.02	7.43		7.21
8/16/2018	7.05	7.59		7.06

### Time Series

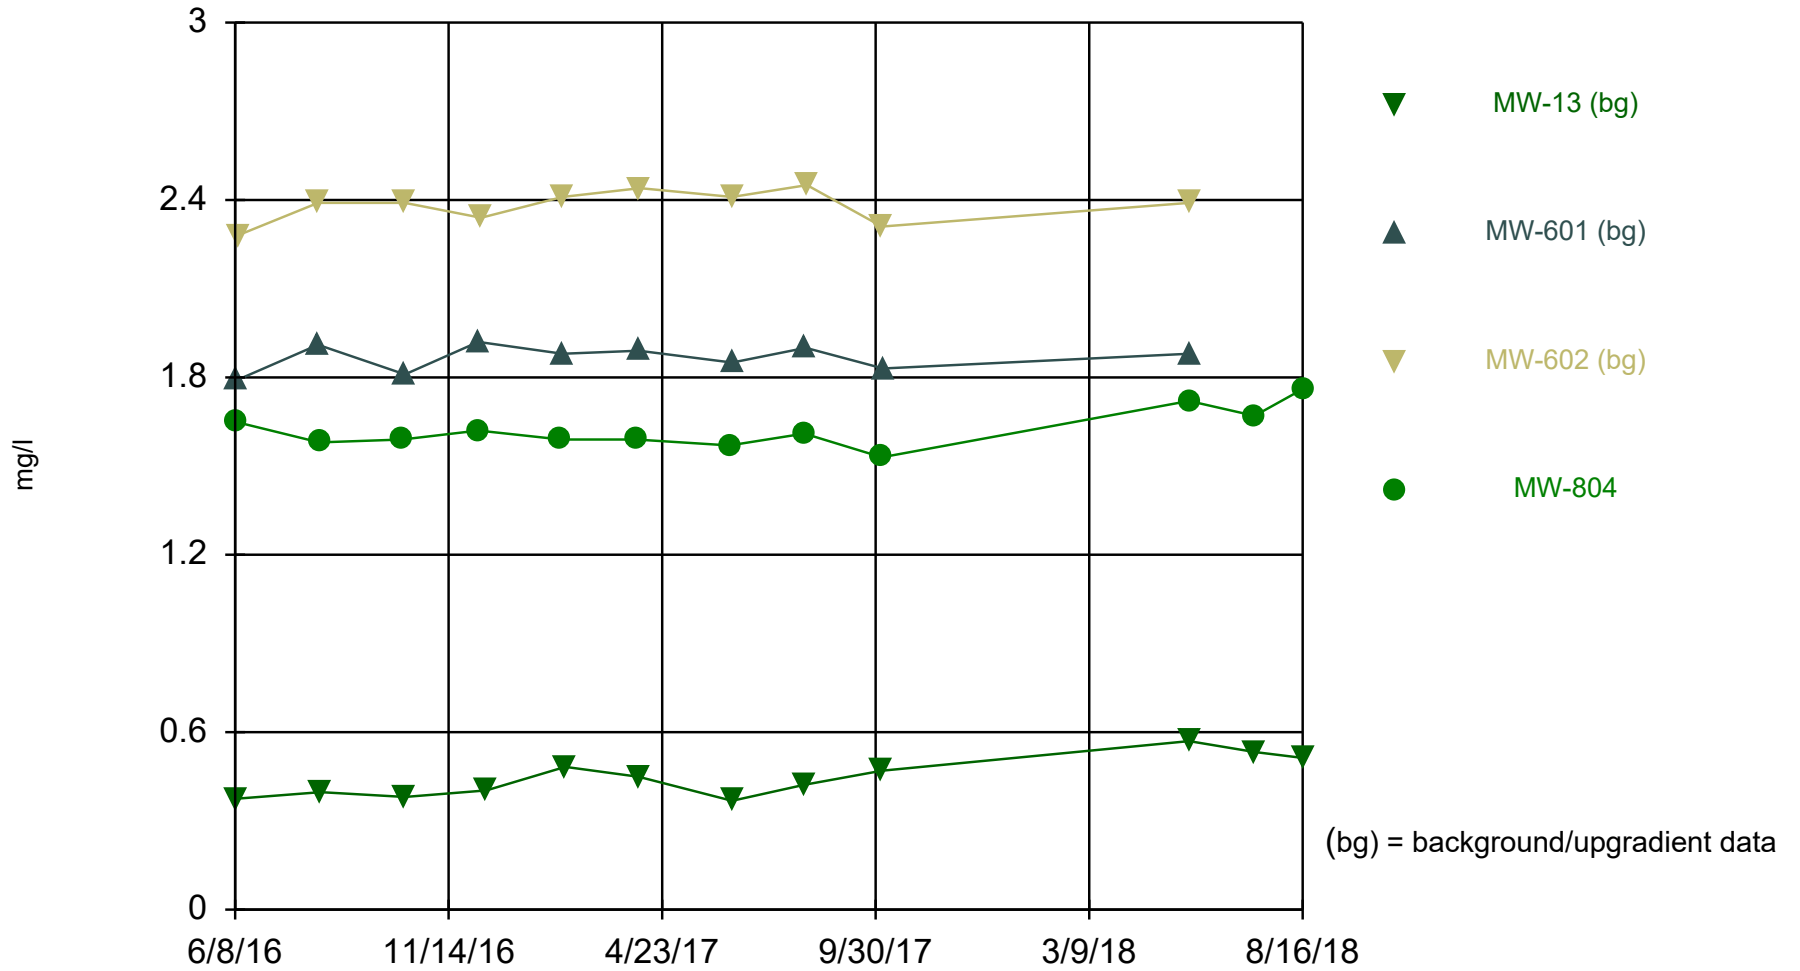

Constituent: BORON Analysis Run 11/12/2018 4:38 PM View: LF LAQC III

LaCygne Client: SCS Engineers Data: LaC GW Data

# Time Series

Constituent: BORON (mg/l) Analysis Run 11/12/2018 4:40 PM View: LF LAQC III

LaCygne Client: SCS Engineers Data: LaC GW Data

---

	MW-13 (bg)	MW-601 (bg)	MW-602 (bg)	MW-804
6/8/2016				1.65
6/9/2016	0.375	1.79		
6/10/2016			2.28	
8/9/2016		1.91	2.39	
8/10/2016				1.58
8/11/2016	0.397			
10/11/2016				1.59
10/13/2016	0.381	1.81	2.39	
12/7/2016		1.92		1.62
12/9/2016			2.34	
12/13/2016	0.403			
2/7/2017				1.59
2/8/2017		1.88	2.41	
2/10/2017	0.483			
4/4/2017				1.59
4/6/2017	0.449	1.89		
4/7/2017			2.44	
6/13/2017				1.57
6/15/2017	0.368	1.85	2.41	
8/8/2017	0.422			1.61
8/9/2017		1.9		
8/10/2017			2.45	
10/5/2017	0.47		2.31	1.53
10/6/2017		1.83		
5/23/2018	0.57	1.88	2.39	1.72
7/11/2018	0.533			1.67
8/16/2018	0.513			1.76